


**EM**

# Panel-mounting thermostats

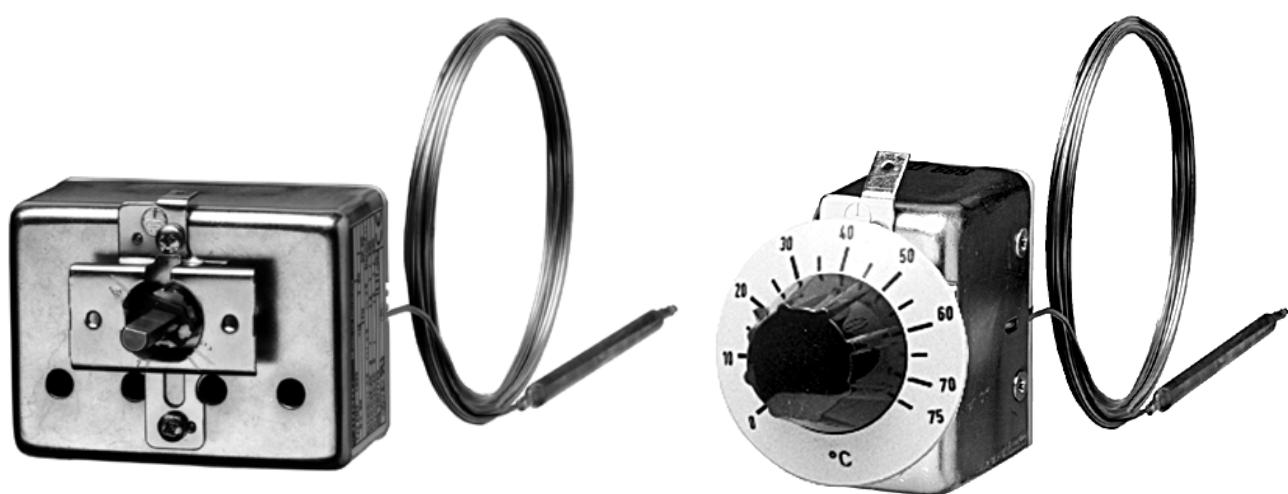

**B 602021.0**  
Operating manual

**JUMO**

V3.00/EN/00073772



Please read these Operating Instructions before commissioning the instrument. Keep the manual in a place that is accessible to all users at all times. Please assist us to improve these operating instructions, where necessary. Your comments will be appreciated.

Phone+49 661 6003-0  
Fax+49 661 6003-607



All necessary settings and possible adjustments inside the instrument are described in these operating instructions. If any problems should still arise during start-up, you are asked not to carry out any unauthorized manipulations on the unit. You could endanger your rights under the instrument warranty! Please contact the nearest subsidiary or the head office in such a case.

# Contents

---

<b>1</b>	<b>Introduction .....</b>	<b>5</b>
<b>1.1</b>	<b>Typographical conventions .....</b>	<b>5</b>
<b>1.1.1</b>	<b>Warning signs .....</b>	<b>5</b>
<b>1.1.2</b>	<b>Note signs .....</b>	<b>5</b>
<b>1.2</b>	<b>Application .....</b>	<b>6</b>
<b>1.3</b>	<b>Marking .....</b>	<b>6</b>
<b>1.4</b>	<b>Safety notes .....</b>	<b>7</b>
<b>2</b>	<b>Instrument identification .....</b>	<b>8</b>
<b>2.1</b>	<b>Type nameplate .....</b>	<b>8</b>
<b>2.2</b>	<b>Type designation .....</b>	<b>9</b>
<b>3</b>	<b>Mounting .....</b>	<b>10</b>
<b>3.1</b>	<b>Dimensions .....</b>	<b>10</b>
<b>3.2</b>	<b>Fixing the panel-mounting thermostat .....</b>	<b>12</b>
<b>3.2.1</b>	<b>Mounting the switch head .....</b>	<b>12</b>
<b>3.3</b>	<b>Capillary / temperature probe / pocket .....</b>	<b>14</b>
<b>3.3.1</b>	<b>General .....</b>	<b>14</b>
<b>3.3.2</b>	<b>Approved probes or pockets .....</b>	<b>14</b>
<b>3.4</b>	<b>Permissible loading on the pocket .....</b>	<b>15</b>
<b>3.4.1</b>	<b>Pockets 20, 22/23, 40 and 41/42 .....</b>	<b>15</b>
<b>4</b>	<b>Installation .....</b>	<b>19</b>
<b>4.1</b>	<b>Regulations and notes .....</b>	<b>19</b>
<b>4.2</b>	<b>Electrical connection .....</b>	<b>19</b>
<b>4.3</b>	<b>Connection diagrams .....</b>	<b>21</b>
<b>5</b>	<b>Settings .....</b>	<b>22</b>
<b>5.1</b>	<b>Unlocking the operating temperature limiter (TB) or protection temperature limiter (STB) .....</b>	<b>22</b>
<b>5.2</b>	<b>Setpoint adjustment .....</b>	<b>23</b>
<b>5.3</b>	<b>Self-monitoring on the STB and STW (STB) .....</b>	<b>23</b>
<b>5.4</b>	<b>Use of the STW (STB) as STB .....</b>	<b>23</b>
<b>6</b>	<b>Instrument description .....</b>	<b>24</b>
<b>6.1</b>	<b>Technical data .....</b>	<b>24</b>

---

## **Contents**

---

<b>7</b>	<b>EU declaration of conformity .....</b>	<b>28</b>
<b>8</b>	<b>China RoHS .....</b>	<b>34</b>

## 1.1 Typographical conventions

### 1.1.1 Warning signs



#### Danger

This symbol is used when there may be **danger to personnel** if the instructions are ignored or not followed correctly!

---



#### Caution

This symbol is used when there may be **damage to equipment** if the instructions are ignored or not followed correctly!

---

### 1.1.2 Note signs



#### Note

This symbol is used when your **special attention** is drawn to a remark.

---



#### Reference

This symbol refers to **further information** in other chapters or sections.

---

abc<sup>1</sup>

#### Footnote

Footnotes are remarks that **refer to specific points** in the text. Footnotes consist of two parts:

A marker in the text, and the footnote text.

The markers in the text are arranged as continuous superscript numbers.

The footnote text (in smaller typeface) is placed at the bottom of the page and starts with a superscript number.

---

\*

#### Action instruction

This symbol indicates that an **action to be performed** is described.

The individual steps are marked by this asterisk, e.g.

\* Open housing

---

# 1 Introduction

---

## 1.2 Application

---

Thermostats control and monitor thermal processes.

Panel-mounting thermostats operate on the principle of liquid or gas expansion. A microswitch serves as the electrical switching device.

The devices of the EM model series can be supplied as temperature controllers TR, operating temperature limiters TW, operating temperature limiters TB, protection temperature limiters STW and protection temperature limiters STB.

In case of faults, the STB switches the plant that it is monitoring into an operationally safe state.

Versions to: DIN EN 14597

TR	Temperature controller
TW	Operating temperature limiter
TB	Operating temperature limiter
STW(STB)	Protection temperature limiter
STB	Protection temperature limiter

Type approval according to:

- DIN EN 14597
- Pressure Equipment Directive  
(only Type EM-20, EM-30, EM-40, EM-50)
- UL
- CSA (only Type EM-1, EM-2, EM-4, EM-50)

You will find the Declarations of Conformity at: [www.jumo.en](http://www.jumo.en)

- Products
  - Temperature
  - Monitor/Limiter
  - Electromechanical
  - Panel-mounting thermostats 60.2021
  - Documentation
  - Declaration of Conformity / White Paper
- or ask for them to be sent.



Cutting through or kinking the capillary of the panel-mounting thermostat, EM series, will lead to permanent instrument failure!!

---

## 1.3 Marking

---

Depending on the version: 0036

(see nameplate for details)

---

## 1.4 Safety notes

---



Filling liquid may escape in the event of a measuring system fracture.  
At present, any health risks can be excluded.

---

Physical and toxicological properties of the expansion fluid that may escape in the event of a system fracture.


Control range with end of scale °C	Dangerous reactions	Fire and explosion hazard		Water contamination	Toxicological data		
		Ignition temperature °C	Explosion limit % v/v		irritant	danger to health	toxic
< +200	no	+355	0.6 - 8	yes	yes	1	no
≥ +200 ≤ +350	no	+490	--	yes	yes	1	no
> +350 ≤ +500	no	no	no	no	no	no	no

<sup>1</sup> At present, there is no restrictive statement from the health authorities concerning any danger to health over short periods and at low concentration, e.g. after a fracture of the measuring system.

---

## 2 Instrument identification

### 2.1 Type nameplate

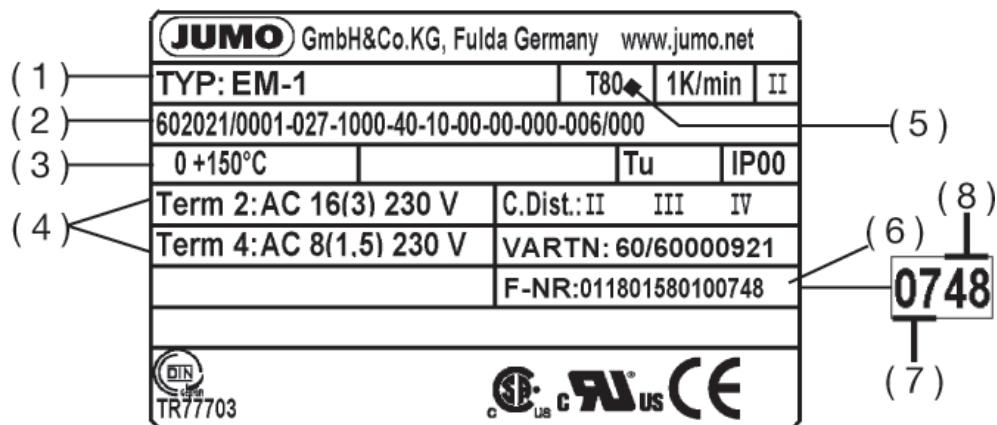

- (1) Type
- (2) Type code
- (3) Regulating or limit value range / ambient temperature at which this thermostat was calibrated (Option)
- (4) Switching capacity
- (5) Permissible ambient temperature
- (6) Serial number
- (7) Date of manufacture
- (8) Week of manufacture

## 2 Instrument identification

---

### 2.2 Type designation

---


Type designation	EM - .. - .. / ..	Panel-mounting thermostat with one microswitch
	EMF - .... - .. / ..	Panel-mounting thermostat with 2, 3 or 4 microswitches
		Standard connection "10" (plain cylindrical probe)
	- 1...	Temperature controller TR with changeover contact
	- 2...	Operating temperature limiter TW with changeover contact
	- 3...	Operating temperature limiter TW with changeover contact; Changeover contact setting fixed at the factory
	- 4...	Operating temperature limiter TB with NC contact and restart inhibit; Changeover contact setting fixed at the factory
	- 5...	Operating temperature limiter TB with NC contact and restart inhibit
	- 20	Protection temperature limiter STW (STB) with changeover contact
	- 30	Protection temperature limiter STW (STB) with changeover contact; Changeover contact setting fixed at the factory
	- 40	Protection temperature limiter STB with NC contact and restart inhibit; Changeover contact setting fixed at the factory
	- 50	Protection temperature limiter STB with NC contact and restart inhibit
	- .... - .. / 707	Temperature compensation at switch head
	- .... - .. / 702	Snap-action switch contacts gold-plated
	- .... - .. / 574	Microswitch with n.c. (break) contact, lock-out and additional signal contact (TB and STB only)

---


# 3 Mounting

## 3.1 Dimensions

EM-1

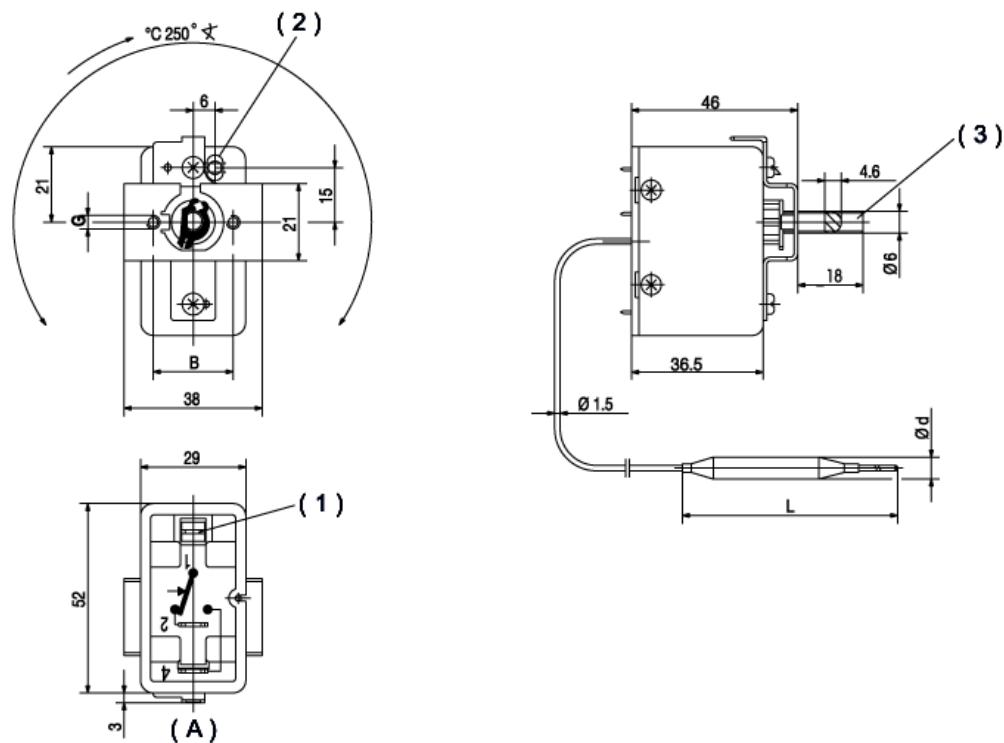

EMF-13

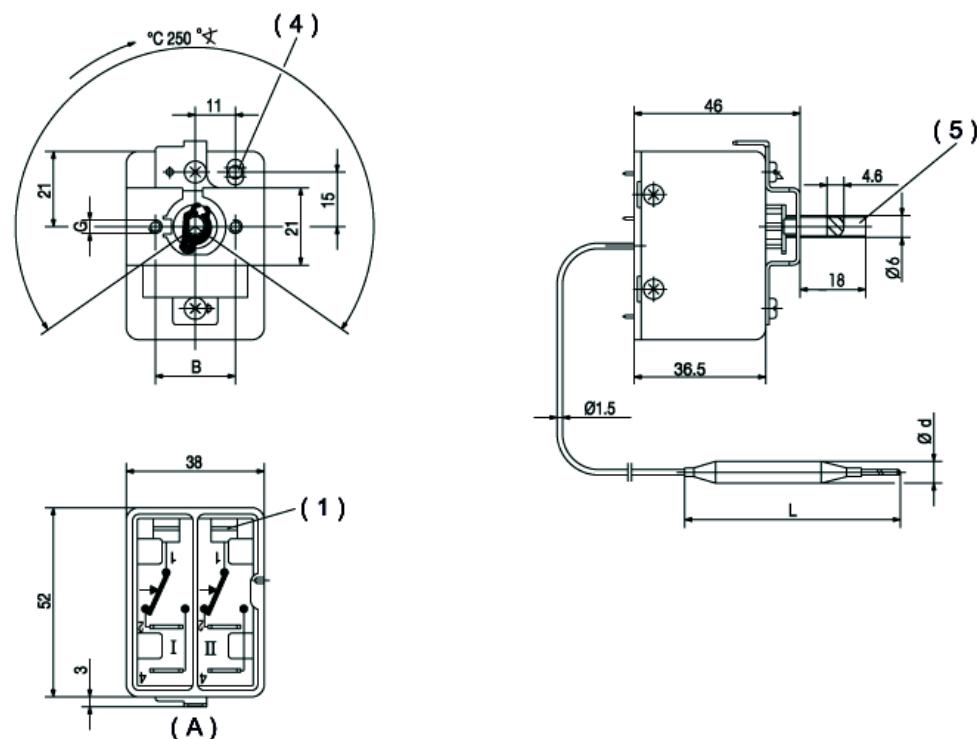

(1) Faston connector A 6.3 x 0.8 to DIN 46 244

(2) Reset button (with codes 4 and 5 only)

(3) omitted with codes 2, 3, 4 and 5


(4) Reset button (with codes 4, 5, 40 and 50 only)

(5) omitted with codes 2, 3, 4, 5, 20, 30, 40, 50


(A) Rear view

### 3 Mounting

EMF-133

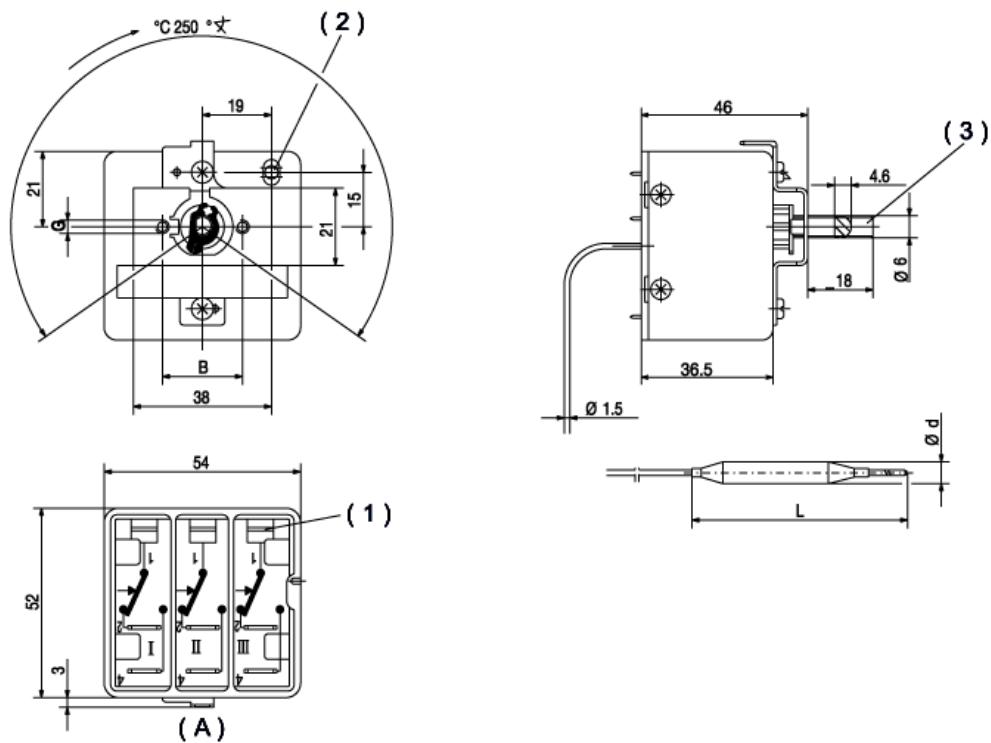

EMF-1333

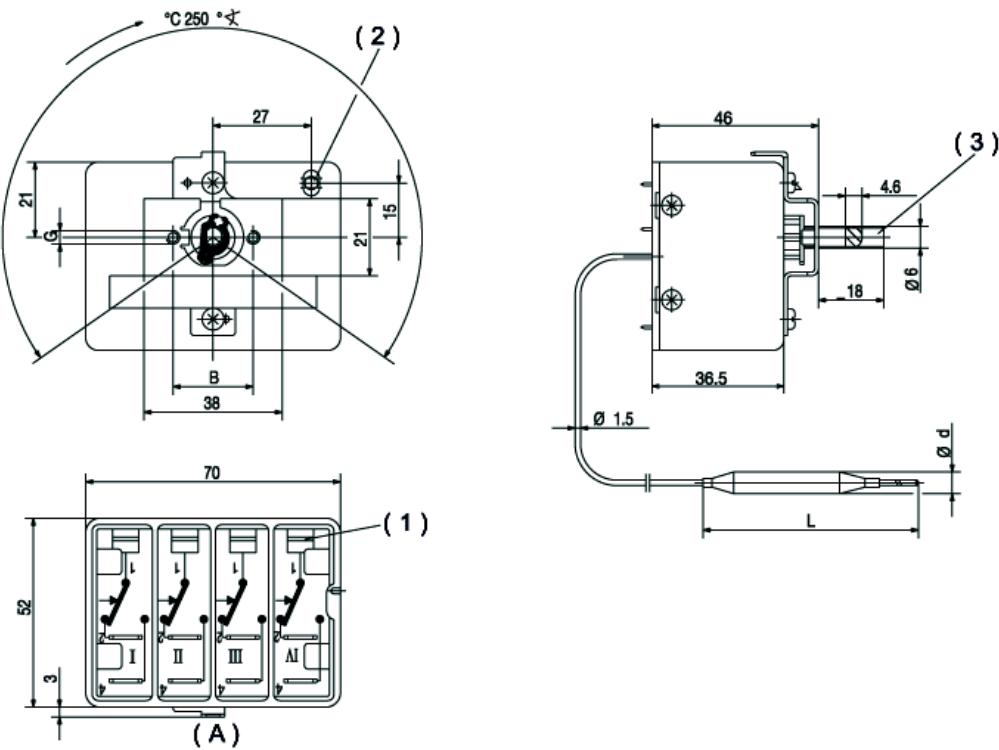

( 1 ) Faston connector A 6.3 x 0.8 to DIN 46 244

( 2 ) Reset button (with codes 4 and 5 only)

( 3 ) omitted with codes 2, 3, 4 and 5

( 4 ) Reset button (with codes 4, 5, 40 and 50 only)

( A ) Rear view

### 3 Mounting

#### 3.2 Fixing the panel-mounting thermostat

**Operating position**

unrestricted


##### 3.2.1 Mounting the switch head

**Type EM.-1...**

by two M3 screws  
(M4 with extra code 704)  
on chassis:

- ( 1 ) Screw
- ( 2 ) Panel

Extra code	Dim. (mm)	
	G	B
Series	3.5	22
704	4.5	28
705	3.5	33

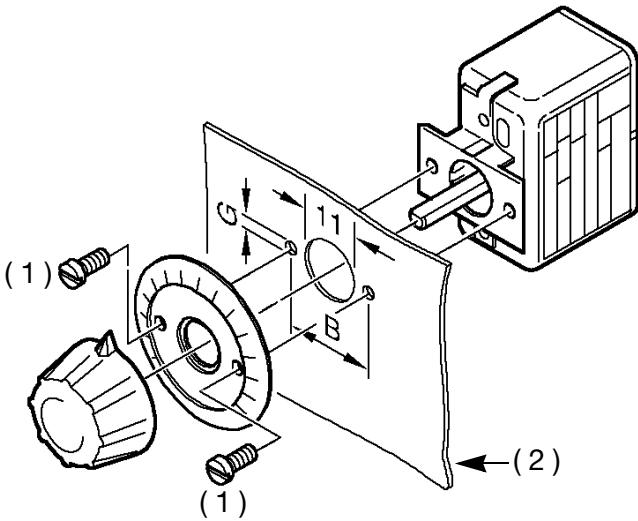


**Type EM.-2... , -3... , -4... , -5... , -20, -30, -40 or -50**

by two M3 screws  
(M4 with extra code 704)  
on chassis:

- ( 1 ) Screw
- ( 2 ) Panel

Type	Dim. (mm)	
	X	Y
EM-2, -3, -20, -30	--	--
EM-4, -5,		6
EM-40, -50		11
EMF-44, -54	15	11
EMF-444, -544		19
EMF-5444		27

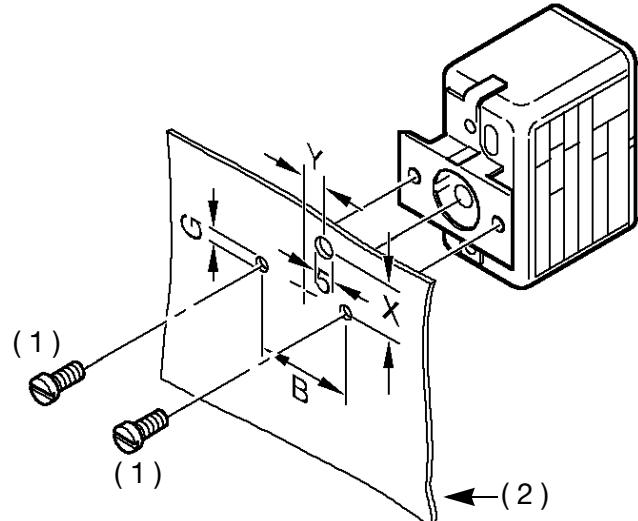


Dimensions B and G, see above

### 3 Mounting

---

**Type EM.-4, -5,  
-40 or -50  
central fixing  
(extra code 710)**

- (1) Panel
- (2) Fixing nut  
M10 x 1 (13 a/f)
- (3) Cap nut M10 x 1  
(10 a/f)
- (4) Reset button

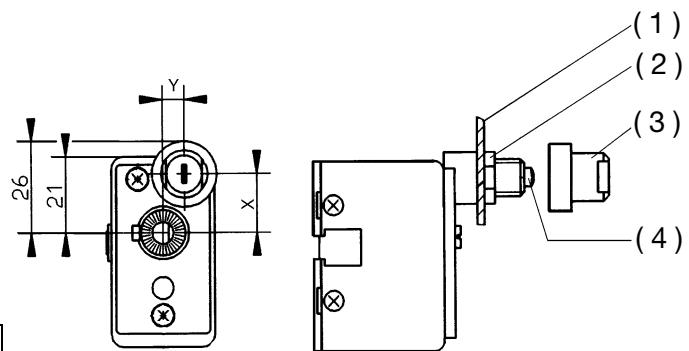

Type	Dim. (mm)	
	X	Y
EM-4, -5	16	6
EM-40, -50,		11

## 3 Mounting

---

### 3.3 Capillary / temperature probe / pocket

#### 3.3.1 General



Cutting through or kinking the capillary of the panel-mounting thermostat will lead to permanent instrument failure!

Minimum permissible bending radius of the capillary is 5 mm.

The temperature probe must be mounted in a JUMO pocket, otherwise the approval of the panel-mounting thermostat becomes invalid.

The temperature probe must be completely immersed in the medium to be measured. The temperature probe or protection tube must **not** come into contact with the walls of the container or pipe.

To ensure their overall accuracy, the thermostats must only be used together with the pockets supplied by the factory (diameter D = 8 or D = 10 mm).


Pockets with diameter D = 10 mm may only be fitted with probes with diameter d = 8 mm.

Fitting several probes into a common pocket is permissible with 2 or 3 cylindrical probes with diameter D = 6 mm and pockets 15 x 0.75 mm.

When fitting 2 probes in a common pocket, the factory-supplied spring clip must be fitted in the pocket.

For operation in air, probe mounting type "10" (without pocket) must be chosen.

In the case of pockets 22, 41, 42 and 45, in materials St35.8 I, the permissible operating life at operating temperatures above +420°C is limited to 200,000 hours. The requirements of TRD 508 must be observed for operation in this range.

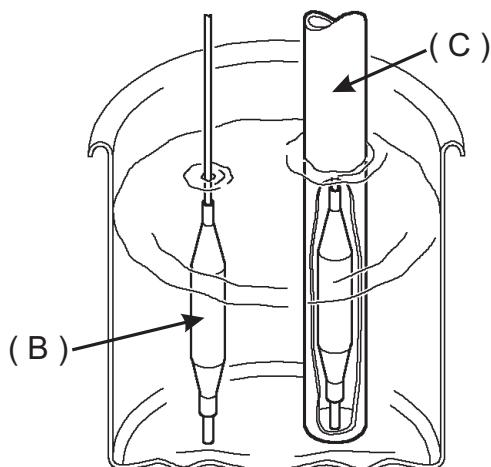

( B ) Immersion tube

( C ) Temperature probe

---

#### 3.3.2 Approved probes or pockets

refer to data sheet 606710 !

## 3.4 Permissible loading on the pocket

### 3.4.1 Pockets 20, 22/23, 40 and 41/42



The values given below refer to the maximum loading on the probe mounting concerned. The maximum pressure which can be sealed depends on the mounting conditions and may possibly be lower.

---

#### 3.4.1.1 Steel pockets 22, 23, 32, 41, 42 and 45

---

<b>Materials</b>	Tube:	St35.8 I
	Screw-in nipple up to 300°C:	Steel 1.0038
	Weld-in nipple:	Steel 1.5415

---

#### Loading

Temperature	Tube diameter D		
	8 x 0.75 mm or conical	10 x 0.75 mm	15 x 0.75 mm
	Max. permissible pressure		
100°C	89 bar	72 bar	48 bar
150°C	83 bar	67 bar	45 bar
200°C	78 bar	63 bar	42 bar
300°C	59 bar	47 bar	32 bar
350°C	50 bar	40 bar	27 bar


---

### 3 Mounting

#### Permissible incident flow velocity


Material:	St35.8 I
Temperature:	+200°C
Thermal medium:	air ( 1 ) water, oil ( 2 )
Tube diameter D:	8 mm 10 mm 15 mm

Permissible incident flow velocity (m/sec) at the maximum permissible pressure loading and different immersion tube lengths "S".

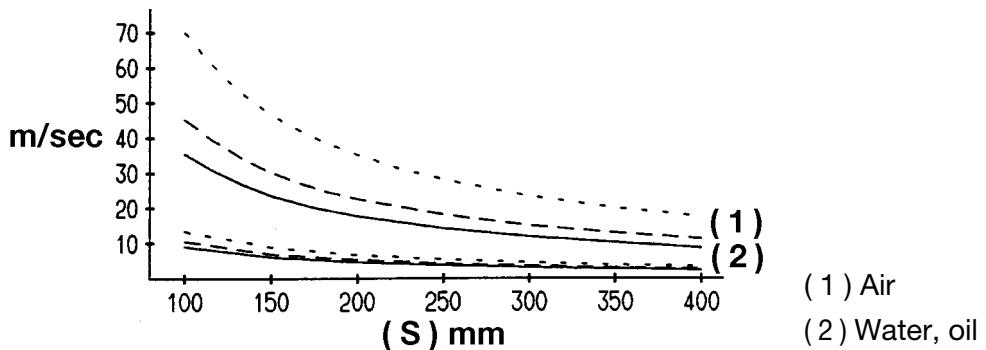

Permissible incident flow velocity (m/sec) at the maximum permissible pressure loading and different immersion tube temperatures "t".

Material:	St35.8 I
Immersion tube length "s":	200 mm
Thermal medium:	air water, oil
Tube diameter D:	8 mm 10 mm 15 mm

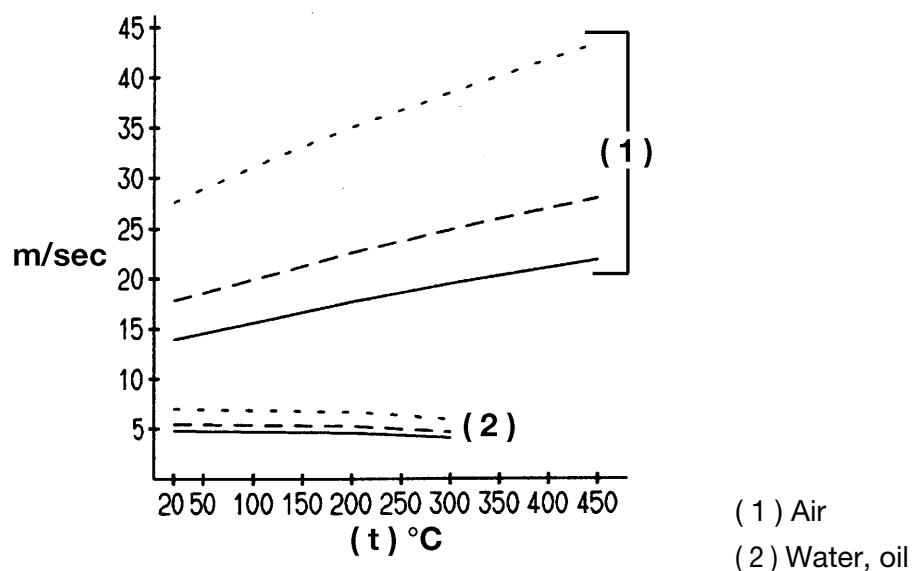

### 3 Mounting

---

#### 3.4.1.2 Stainless steel pockets 20, 22, 40 and 41/42

##### Loading

Material of tube and nipple: stainless steel (1.4571)			
Temperature	Tube diameter D		
	8 x 0.75 mm or conical	10 x 0.75 mm	15 x 0.75 mm
	Max. permissible pressure		
100°C	92 bar	74 bar	50 bar
150°C	88 bar	71 bar	48 bar
200°C	83 bar	67 bar	45 bar
300°C	72 bar	58 bar	39 bar
400°C	67 bar	54 bar	36 bar

---

#### 3.4.1.3 Brass pockets 20 and 40

##### Loading

Material of tube and nipple: CuZn			
Temperature	Tube diameter D		
	8 x 0.75 mm	10 x 0.75 mm	15 x 0.75 mm
	Max. permissible pressure		
100°C	50 bar	40 bar	27 bar
150°C	48 bar	39 bar	26 bar

---

### 3 Mounting

#### 3.4.1.4 Probe mountings 50, 52 and 54

Nipple material	CuZn	steel	stainless steel (1.4571)
Temperature °C	200	300	400


Probe material	Ø mm	Thermostat action	
		TR, TW, TB	STB, STW (STB)
Cu-DHP	4	6 bar	2 bar
	5	5 bar	
	6	4 bar	
	7	3 bar	
	8	3 bar	
	9	3 bar	
	10	3 bar	
St35 / 1.4571	4 - 10	10 bar	2 bar



**Forms 10, 15, 21, 60, 65 may only be used in unpressurized media.**



The temperature probe (2) must be immersed in the medium for its entire length, otherwise there will be appreciable deviations from the switching point. In the case of probe mountings 20, 22/23 and 21, the temperature probe is secured in the pocket by a clamping clip (1).

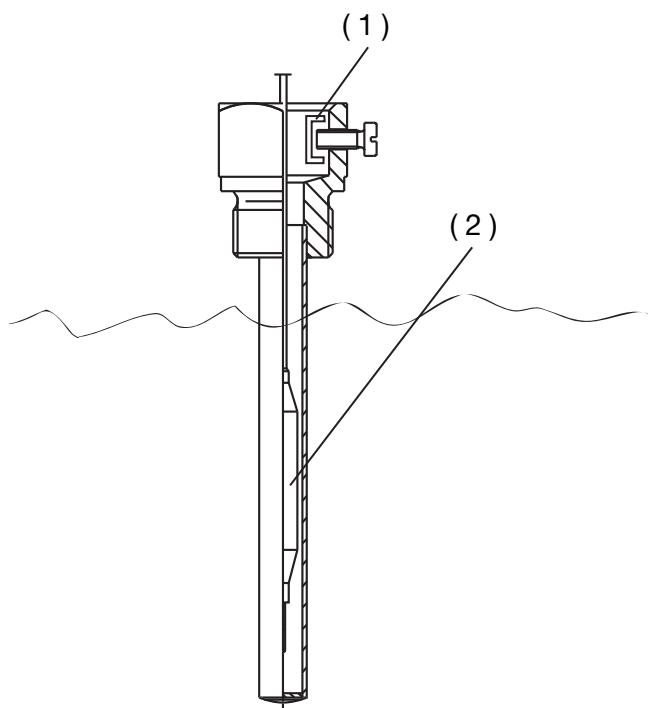

### 4.1 Regulations and notes



- The electrical connection must only be carried out by qualified personnel.
  - The choice of cable, the installation and the electrical connection must conform to the requirements of VDE 0100 "Regulations on the Installation of Power Circuits with Nominal Voltages below 1000 V" or the appropriate local regulations.
  - If contact with live parts is possible while working on the instrument, it must be completely disconnected from the electrical supply.
  - Earth the instrument at the PE terminal to the protective earth conductor. This cable must have at least the same cross-section as used for the supply cables. Earthing cables must be wired in a star configuration to a common earth point that is connected to the protective earth conductor of the electrical supply. Do not loop earthing cables, i.e. do not run them from one instrument to another.
  - Apart from faulty installation, incorrect settings on the thermostat may also affect the proper functioning of the subsequent process or lead to damage. Setting up must therefore be restricted to qualified personnel. Please observe the relevant safety regulations for such matters.
- 

### 4.2 Electrical connection

- Terminals and connections are suitable for internal conductors
- The connection is suitable for fixed wiring.
- Cable entry without strain relief



- The thermostat conforms to Protection Class I.

**Capillary tube has no protective conductor function!**


With respect to the probe and capillary, the user himself is responsible for taking the necessary protective measures against electric shock.

---

## 4 Installation


---

### Plug connection (standard)

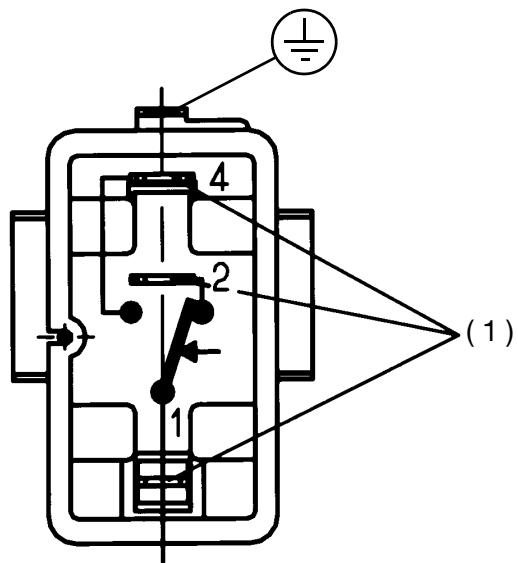











(1) = faston connector A 6.3 x 0.8 to DIN 46 244

### Screw connection (extra code 699)

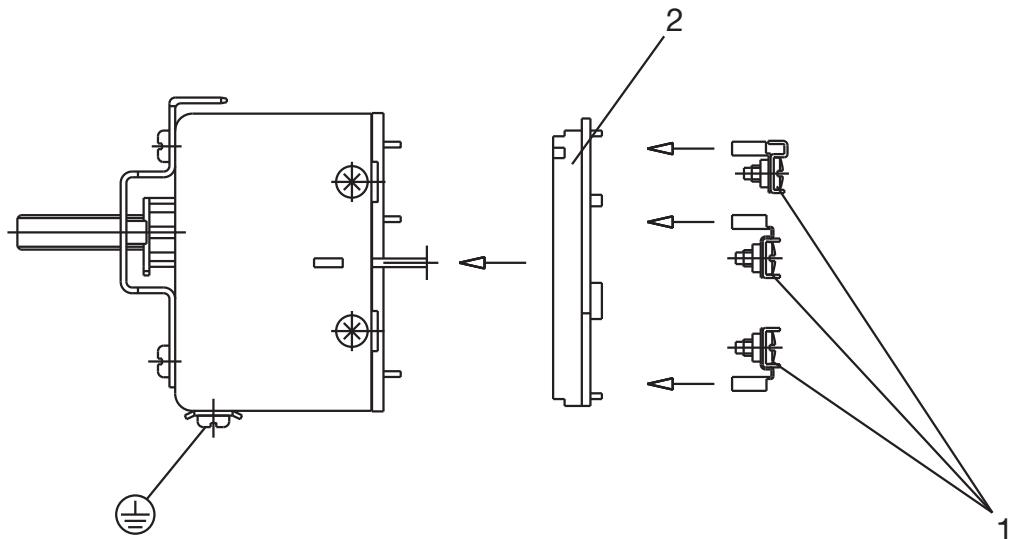

- (1) Receptacle 6.3 with connection screw, suitable for conductor cross-sections up to 2.5 mm<sup>2</sup>; attachment type X, no special tools
  - (2) Terminal strip
-

### 4.3 Connection diagrams

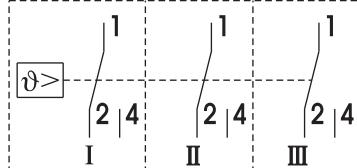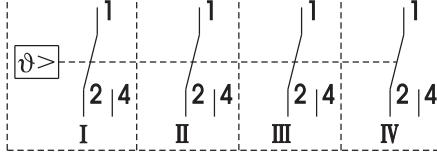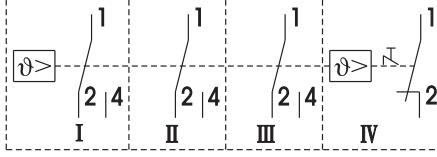EM-1 EM-2 EM-3		EM-4 EM-5	
EMF-13 EMF-23 EMF-33  Setpoint: I Follow-on contact: II		EMF-4/574 EMF-5/574	
EMF-133 EMF-233 EMF-333  Setpoint: I Follow-on contact: II, III		EM-40 EM-50 n.c. (break) contact on measuring system failure and T < -10 °C: I limit: II	
EMF-1333 EMF-2333 EMF-3333  Setpoint: I Follow-on contact: II, III, IV		EM-40/574 EM-50/574	
		EM-20 EM-30 n.c. (break) contact on measuring system failure and T < -10 °C: I limit: II	
Example: EMF-1334		For other variants, the connection diagrams are combined appropriately.	

## 5 Settings

---

### 5.1 Unlocking the operating temperature limiter (TB) or protection temperature limiter (STB)

---

**EM-4**

**EMF-4...**

**EM-5**


**EMF-5...**

**EM-40**

**EM-50**

**with fixing  
bracket 704,  
705**

After the temperature has dropped by about 10% of span below the set limit (critical temperature), the microswitch can be reset.

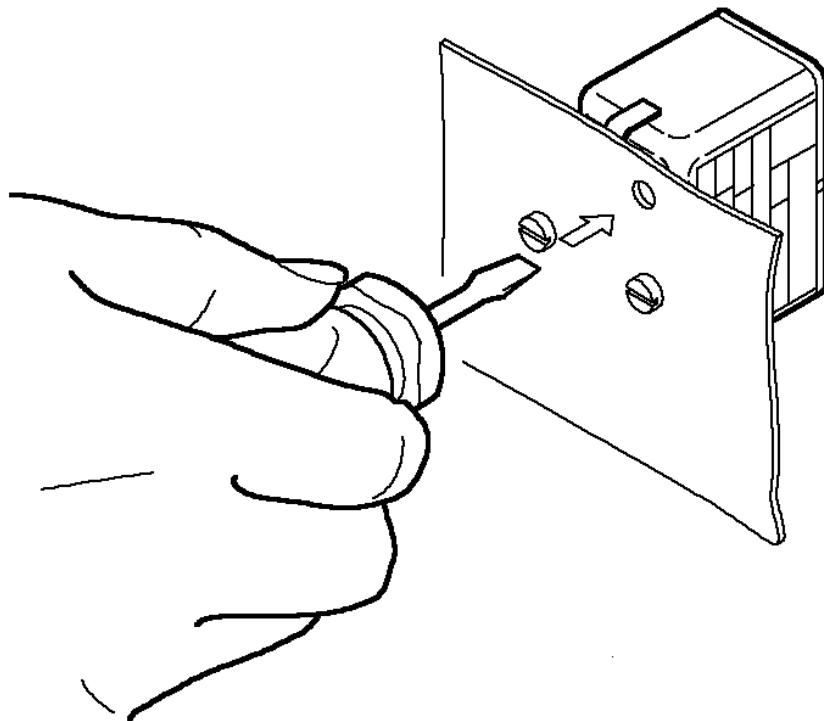

\* Push the reset button using a small screwdriver

---

**EM-4**

**EMF-4...**


**EM-5**

**EMF-5...**

**EM-40**

**EM-50**

**with central  
fixing 710**

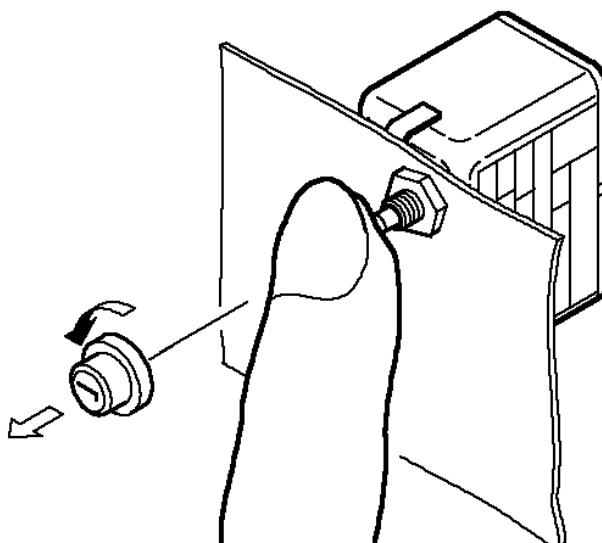


- \* Unscrew cap
  - \* Press reset button
  - \* Screw cap back into position
-

### 5.2 Setpoint adjustment


<b>EM-1</b>	( 1 ) Setpoint marker
<b>EMF-1...</b>	( 2 ) External scale
<b>EM-5</b>	( 3 ) Setpoint knob
<b>EMF-5...</b>	( 4 ) Scale graduation

- \* Rotate the setpoint knob by hand over the external scale

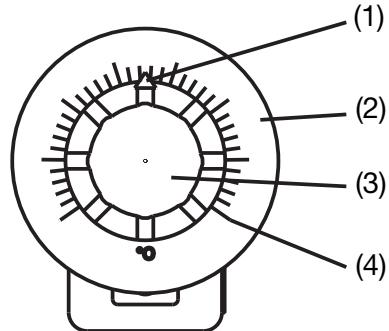

<b>EM-2</b>	( 1 ) Setpoint spindle
<b>EMF-2...</b>	( 2 ) Scale graduation
<b>EM-5</b>	( 3 ) Setpoint marker
<b>EMF-5...</b>	

- \* Rotate the setpoint spindle over the internal scale using a screwdriver

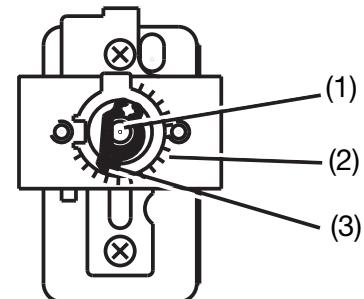

<b>EM-3</b>
<b>EMF-3...</b>
<b>EM-4</b>
<b>EMF-4...</b>
<b>EM-30</b>
<b>EM-40</b>



The limit setting is fixed at the factory and sealed.  
It must subsequently not be adjusted.

### 5.3 Self-monitoring on the STB and STW (STB)



If the measuring system fails, i.e. if the expansion liquid has leaked, then the pressure under the diaphragm drops and the circuit is permanently open. It is no longer possible to reset the system.

The electrical circuit opens when cooling the probe of STW (STB) and STB down to the negative temperature range, but it then closes again if the temperature rises. The STB must be unlocked manually if the minimum probe temperature is exceeded. The STW unlocks itself automatically.

### 5.4 Use of the STW (STB) as STB



The lock-out facility to DIN EN 14597 must be ensured by the subsequent circuit. This circuit must comply with VDE 0116.

# 6 Instrument description

## 6.1 Technical data

**Permissible ambient temperature**

	Capillary		Switch head		for end of scale
	TR,TW	TB, STW(STB) STB	TR,TW	TB, STW(STB) STB	
max.	see nameplate				
min.	-40 °C	-20 °C	-20 °C	0 °C	< 200 °C
	-20 °C				≥ 200 °C ≤ 350 °C
	-40 °C				> 350 °C ≤ 500 °C

**Permissible probe temperature**

max.: end of scale / limit value +15%,  
(for end of scale between +90 °C and 120 °C = min. 25 °C)  
min.: -50 °C (on STW(STB) and STB -35 °C)

**Permissible storage temperature**

max. +50 °C, min. -50 °C

**Housing**

galvanized steel sheet

**Switching device**

Type EM-....	Description
	1, 2, 3 or 4 single-pole snap-action switches
1, 2, 3, 20, 30	with changeover contact
4, 5, 40, 50	with n.c. (break) contact
4/574, 5/574, 40/574, 50/574	n.c. (break) contact with additional signal contact

## 6 Instrument description

---

### Contact rating

Type EM-...	Switching differential %	Current		Voltage			
		Terminal 2	Terminal 4				
1, 2, 3, 20, 30	2.5 / 5 / 7 / 10	10 A	2 A	400 V AC +10%			
4, 5, 40, 50	--		--				
1, 2, 3, 20, 30	2.5 / 5 / 6 / 7 / 10	16(3)	8(1.5) A	230 V AC +10% p.f. = 1 (0.6)			
		0.25 A	0.25 A	230 V DC +10%			
1, 2, 3, 20, 30	1 / 3	6(2)		230 V AC +10% p.f. = 1 (0.6)			
		0.25 A		230 V DC +10%			
4, 5, 40, 50	--	16(3) A	--	230 V AC +10% p.f. = 1 (0.6)			
		0.25 A		230 V DC +10%			
		0.1 A extra code "702"		24 V AC/DC			
4/574, 5/574, 40/574, 50/574	--	16(3) A	2(1) A	230 V AC +10% p.f. = 1 (0.6)			
		0.25 A		230 V DC +10%			
		0.1 A extra code "702"		24 V AC/DC			
<b>Contact reliability</b>							
To ensure maximum switching reliability, we recommend a minimum load of:							
<ul style="list-style-type: none"> <li>- AC / DC 24 V, 100 mA with silver contacts (standard)</li> <li>- AC / DC 10 V, 5 mA in case of gold-plated contacts (extra code "702")</li> </ul>							
<b>Rated surge voltage</b>							
2500 V (via the connecting contacts 400 V)							
<b>Overvoltage category II</b>							
<b>Fusing required</b>							
see current rating							

---

## 6 Instrument description

---

**Switching point accuracy** (in % of scale span; referred to setpoint or limit value at  $T_A +22^\circ\text{C}$ , with rising temperature)

Type EM-...	Switching differential in % liquid-filled	Switching differential in % gas-filled	Switching point accuracy in % in upper third of scale or at limit	Switching point accuracy in % at start of scale
1	1 / 2.5	--	$\pm 1.5$	$\pm 4$
	5	3 / 5	$\pm 3$	$\pm 5$
	7	6 / 10	$\pm 4$	$\pm 6$
2, 3	1 / 2.5	--	+0 / -3	+0 / -5
	5	3 / 5	+0 / -6	+0 / -8
	7	6 / 10	+0 / -8	+0 / -10
4, 4/574, 5, 5/574	--	--	+0 / -5	+0 / -7
20, 30	7	10	+0 / -8	+0 / -10
40, 40/574, 50, 50/574	--	--		

---

**Protection** EN 60 529 - IP00  
Pollution degree 2

---

**Operating medium** water, oil, air, superheated steam

---

<b>Time constant</b> $t_{0.632}$	in water	in oil	in air / superheated steam
	$\leq 45 \text{ sec}$	$\leq 60 \text{ sec}$	$\leq 120 \text{ sec}$

---

**Mode of operation** as per EN 60 730-1, DIN EN 60 730-2-9 and DIN EN 14597

**TR, TW** 2 BL  
**TB** 2 BFHLPV  
**STW(STB):** 2 BKLPN  
**STB** 2 BFHKLNPV

**Explanation of codes:**

- 2** mode of operation type 2
- B** automatic mode of operation with micro-disconnection
- F** can only be reset with tools
- H** free-release mechanism, contacts cannot be prevented from opening
- K** with probe break protection
- L** no auxiliary power required
- P** mode of operation type 2, verified through declared temperature cycling
- V** lockout

## 6 Instrument description

---

<b>Nominal position</b>	unrestricted																										
<b>Weight</b>	approx. 0.2 kg																										
<b>Capillary and probe material</b>	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th style="text-align: left; padding: 2px;">End of scale</th> <th style="text-align: left; padding: 2px;">Capillary</th> <th style="text-align: left; padding: 2px;">Probe</th> </tr> </thead> <tbody> <tr> <td style="padding: 2px;">up to +200 °C</td><td style="padding: 2px;">copper, Mat. Ref. Cu-DHP 1.5 mm diameter</td><td style="padding: 2px;">copper, Mat. Ref. Cu-DHP brazed</td></tr> <tr> <td style="padding: 2px;">up to +350 °C</td><td style="padding: 2px;">copper, Mat. Ref. Cu-DHP 1.5 mm diameter</td><td style="padding: 2px;">stainless steel, Mat. Ref. 1.4571 brazed</td></tr> <tr> <td style="padding: 2px;">up to +500 °C</td><td style="padding: 2px;">stainless steel, 1.5 mm diameter</td><td style="padding: 2px;">stainless steel, Mat. Ref. 1.4571 welded</td></tr> <tr> <td colspan="3" style="text-align: center; padding: 2px;">at extra cost</td></tr> <tr> <td style="padding: 2px;">up to +350 °C</td><td style="padding: 2px;">stainless steel, 1.5 mm diameter</td><td style="padding: 2px;">stainless steel, Mat. Ref. 1.4571 welded</td></tr> </tbody> </table>									End of scale	Capillary	Probe	up to +200 °C	copper, Mat. Ref. Cu-DHP 1.5 mm diameter	copper, Mat. Ref. Cu-DHP brazed	up to +350 °C	copper, Mat. Ref. Cu-DHP 1.5 mm diameter	stainless steel, Mat. Ref. 1.4571 brazed	up to +500 °C	stainless steel, 1.5 mm diameter	stainless steel, Mat. Ref. 1.4571 welded	at extra cost			up to +350 °C	stainless steel, 1.5 mm diameter	stainless steel, Mat. Ref. 1.4571 welded
End of scale	Capillary	Probe																									
up to +200 °C	copper, Mat. Ref. Cu-DHP 1.5 mm diameter	copper, Mat. Ref. Cu-DHP brazed																									
up to +350 °C	copper, Mat. Ref. Cu-DHP 1.5 mm diameter	stainless steel, Mat. Ref. 1.4571 brazed																									
up to +500 °C	stainless steel, 1.5 mm diameter	stainless steel, Mat. Ref. 1.4571 welded																									
at extra cost																											
up to +350 °C	stainless steel, 1.5 mm diameter	stainless steel, Mat. Ref. 1.4571 welded																									
<b>Minimum bending radius of capillary</b>	5 mm																										
<b>Mean ambient temperature error</b>	<p>in % of scale span, referred to the limit value.  A deviation of the ambient temperature at the switch head and/or the capillary from the +22 °C calibration ambient temperature produces a shift in the switching point:  higher ambient temperature = lower switching point  lower ambient temperature = higher switching point</p>																										
For temperatures with end of scale / limit value																											
< +200 °C				≥ +200 °C ≤ +350 °C			≥ +400 °C ≤ +500 °C																				
TR, TW, TB			STW STB	TR, TW, TB		STW, STB	TR, TW, TB STW, STB																				
Switching differential in %																											
1 / 2.5	5	7	7 / --	1 / 2.5	5	7 / --	3.5	6	10																		
Ambient temperature effect due to the switch head, % per °C																											
0.15	0.26	0.34	0.43	0.12	0.21	0.35	0.12	0.17	0.24																		
Ambient temperature effect due to the capillary, % per °C per meter																											
0.05	0.09			0.04		0.07	0.05																				
<b>Temperature compensation (extra code 707)</b>	Please see the diagram in Data Sheet 602021 for details.																										

## 7 EU declaration of conformity

JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1  
36039 Fulda, Germany

Tel.: +49 661 6003-0  
Fax: +49 661 6003-500

E-Mail: mail@jumo.net  
Internet: www.jumo.net



More than sensors + automation

### EU-Konformitätserklärung

EU declaration of conformity / Déclaration UE de conformité

**Dokument-Nr.**

CE 639

*Document No. / Document n°.*

**Hersteller**

JUMO GmbH & Co. KG

*Manufacturer / Etabli par*

**Anschrift**

Moritz-Juchheim-Straße 1, 36039 Fulda, Germany

*Address / Adresse*

**Produkt**

*Product / Produit*

**Name**

*Name / Nom*

**Typ**

*Type / Type*

**Typenblatt-Nr.**

*Data sheet no. / N°*

*Document*

*d'identification*

Einbau-Thermostat EM

602021

602021

**Wir erklären in alleiniger Verantwortung, dass das bezeichnete Produkt die Anforderungen der Europäischen Richtlinien erfüllt.**

*We hereby declare in sole responsibility that the designated product fulfills the requirements of the European Directives.*

*Nous déclare sous notre seule responsabilité que le produit remplit les Directives Européennes.*

**Richtlinie 1**

*Directive / Directive*

**Name**

*Name / Nom*

EMC

**Fundstelle**

*Reference / Référence*

2014/30/EU

**Bemerkung**

*Comment / Remarque*

**Datum der Erstanbringung des CE-Zeichens auf dem Produkt**

*Date of first application of the CE mark to the product / Date*

*de 1ère application du sigle sur le produit*

Dokument-Nr.

*Document No. / Document n°.*

CE 639

EU-Konformitätserklärung

Seite: 1 von 5

## 7 EU declaration of conformity

### JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1 Tel.: +49 661 6003-0  
36039 Fulda, Germany Fax: +49 661 6003-500  
E-Mail: mail@jumo.net  
Internet: www.jumo.net



More than **sensors + automation**

### Angewendete Normen/Spezifikationen

Standards/Specifications applied / Normes/Spécifications appliquées

Fundstelle	Ausgabe	Bemerkung
Reference / Référence	Edition / Édition	Comment / Remarque
EN 60730-1	2011	
EN 60730-2-9	2010	

### Gültig für Typ

Valid for Type / Valable pour le type

602021/...

---

### Richtlinie 2

Directive / Directive

Name	LVD
Name / Nom	
Fundstelle	2014/35/EU
Reference / Référence	
Bemerkung	
Datum der Erstanbringung des CE-Zeichens auf dem Produkt	1995
Date of first application of the CE mark to the product / Date de 1ère application du sigle sur le produit	

### Angewendete Normen/Spezifikationen

Standards/Specifications applied / Normes/Spécifications appliquées

Fundstelle	Ausgabe	Bemerkung
Reference / Référence	Edition / Édition	Comment / Remarque
EN 60730-1	2011	
EN 60730-2-9	2010	

### Gültig für Typ

Valid for Type / Valable pour le type

602021/...

Dokument-Nr.  
Document No. / Document n°.

CE 639

EU-Konformitätserklärung

Seite: 2 von 5

## 7 EU declaration of conformity

JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1  
36039 Fulda, Germany

Tel.: +49 661 6003-0  
Fax: +49 661 6003-500

E-Mail: mail@jumo.net  
Internet: www.jumo.net



More than sensors + automation

### Richtlinie 3

Directive / Directive

**Name** PED

Name / Nom

**Fundstelle** 2014/68/EU

Reference / Référence

**Bemerkung** Mod. B+D; Cat. IV

Comment / Remarque

**Datum der Erstanbringung des CE-Zeichens** 1996

**auf dem Produkt**

Date of first application of the CE mark to the product / Date

de 1ère application du sigle sur le produit

### Gültig für Typ

Valid for Type / Valable pour le type

602021/...

### EU-Baumusterprüfungsberechtigung 3.1

EU type examination certificate / Certificat d'examen de type UE

**Fundstelle** Z-IS-TAF-MUC-18-06-2652099-07102504

Reference / Référence

**Benannte Stelle** TÜV SÜD Industrie Service GmbH

Notified Body / Organisme notifié

**Kennnummer** 0036

Identification no. / N° d'identification

### Angewendete Normen/Spezifikationen

Standards/Specifications applied / Normes/Spécifications appliquées

**Fundstelle**

**Ausgabe**

**Bemerkung**

Reference / Référence

Edition / Édition

Comment / Remarque

EN 14597

2012

### Anerkannte Qualitätssicherungssysteme der Produktion

Recognized quality assurance systems of production / Systèmes de qualité reconnus de production

**Benannte Stelle**

**Kennnummer**

Notified Body / Organisme notifié

Identification no. / N° d'identification

TÜV SÜD Industrie Service GmbH

0036

Dokument-Nr.

Document No. / Document n°.

CE 639

EU-Konformitätserklärung

Seite: 3 von 5

## 7 EU declaration of conformity

### JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1 Tel.: +49 661 6003-0  
36039 Fulda, Germany Fax: +49 661 6003-500

E-Mail: mail@jumo.net  
Internet: www.jumo.net



More than sensors + automation

#### Richtlinie 4

Directive / Directive

**Name** RoHS

Name / Nom

**Fundstelle** 2011/65/EU

Reference / Référence

#### Bemerkung

Comment / Remarque

**Datum der Erstanbringung des CE-Zeichens** 2017  
**auf dem Produkt**

Date of first application of the CE mark to the product / Date  
de 1ère application du sigle sur le produit

#### Angewendete Normen/Spezifikationen

Standards/Specifications applied / Normes/Spécifications appliquées

**Fundstelle**

Reference / Référence

**Ausgabe**

Edition / Édition

**Bemerkung**

Comment / Remarque

VDK Umweltrelevante Aspekte V1

bei der Produktentwicklung und  
-gestaltung

#### Gültig für Typ

Valid for Type / Valable pour le type

602021/...

## 7 EU declaration of conformity

### JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1  
36039 Fulda, Germany

Tel.: +49 661 6003-0  
Fax: +49 661 6003-500

E-Mail: mail@jumo.net  
Internet: www.jumo.net



More than sensors + automation

#### Aussteller

*Issued by / Etabli par*

#### Ort, Datum

*Place, date / Lieu, date*

#### Rechtsverbindliche Unterschriften

*Legally binding signatures /*

*Signatures juridiquement valable*

JUMO GmbH & Co. KG

Fulda, 2018-06-22

Bereichsleiter Vertrieb Inland / Globales  
Produkt- und Branchenmanagement  
ppa. Dimitrios Charisiadis

Qualitätsbeauftragter und Leiter Qualitätswesen  
i. V. Harald Gienger

## **7 EU declaration of conformity**

---

## 8 China RoHS

	 More than sensors + automation					
产品组别 Product group: 602021	产品中有害物质的名称及含量 China EEP Hazardous Substances Information					
部件名称 Component Name						
	铅 ( Pb )	汞 ( Hg )	镉 ( Cd )	六价铬 ( Cr(VI) )	多溴联苯 ( PBB )	多溴二苯醚 ( PBDE )
外壳 Housing (Gehäuse)	X	○	○	○	○	○
过程连接 Process connection (Prozessanschluss)	○	○	○	○	○	○
螺母 Nuts (Mutter)	○	○	○	○	○	○
螺栓 Screw (Schraube)	○	○	○	○	○	○
<p>本表格依据SJ/T 11364的规定编制。            This table is prepared in accordance with the provisions SJ/T 11364.            ○ : 表示该有害物质在该部件所有均质材料中的含量均在GB/T 26572规定的限量要求以下。            Indicate the hazardous substances in all homogeneous materials' for the part is below the limit of the GB/T 26572.</p> <p>* : 表示该有害物质至少在该部件的某一均质材料中的含量超出GB/T 26572规定的限量要求。            Indicate the hazardous substances in at least one homogeneous materials' of the part is exceeded the limit of the GB/T 26572.</p>						



**JUMO GmbH & Co. KG**

Street address:  
Moritz-Juchheim-Straße 1  
36039 Fulda, Germany  
Delivery address:  
Mackenrodtstraße 14  
36039 Fulda, Germany  
Postal address:  
36035 Fulda, Germany  
Phone: +49 661 6003-0  
Fax: +49 661 6003-607  
E-mail: mail@jumo.net  
Internet: www.jumo.net

**JUMO Instrument Co. Ltd.**

JUMO House  
Temple Bank, Riverway  
Harlow - Essex CM20 2DY, UK  
Phone: +44 1279 63 55 33  
Fax: +44 1279 63 52 62  
E-mail: sales@jumo.co.uk  
Internet: www.jumo.co.uk

**JUMO Process Control, Inc.**

6733 Myers Road  
East Syracuse, NY 13057, USA  
Phone: 315-437-5866  
1-800-554-5866  
Fax: 315-437-5860  
E-mail: info.us@jumo.net  
Internet: www.jumousa.com